


SMDS  
SEALED MODULATING  
DAMPER SYSTEM

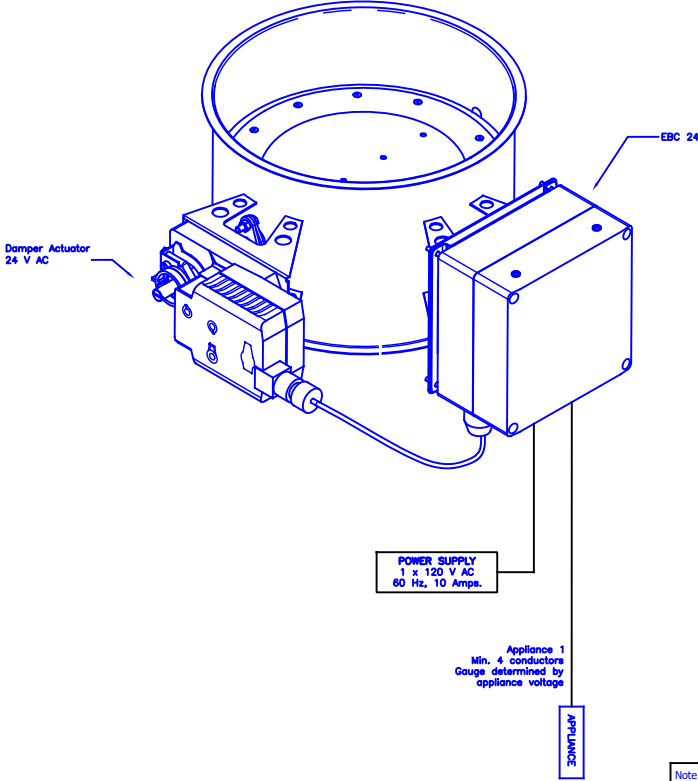

Note:  
The wire sizes shown are typical and may not apply to all jobs. This system must be installed in compliance with the NFPA 70 National Electric Code and/or any local codes.

—— Line Voltage      - - - - Low Voltage Signal

PROPRIETARY AND  
CONFIDENTIAL

The information contained in this drawing is the sole property of ENERVEX, Inc. Any reproduction in part or as a whole with out the express written consent of ENERVEX, Inc. is prohibited.

NOT TO SCALE

<b>ENERVEX®</b> <i>GREEN BEFORE GREEN WAS IN</i>		1685 Bluegrass Lakes Pkwy Alpharetta, GA 30004 (770)587-3238 Fax (770)587-4731
TITLE	CONNECTION DIAGRAM	DATE 2/16/2024
NAME	EXHAUST ONLY - SMDS	JOB # Generic
DWG BY YKH	SHEET 1 OF 2	REV # 0